

A Fuzzy Based PV-APF Controller For Compensating Current Harmonics

P.Srinivasa Varma

(Electrical and Electronics Engineering, KL University, India)

Abstract : The main aim of this paper is to compensate a current harmonics in PV-APF system using Fuzzy Logic Controller. A 3- Φ 3-wire system is proposed in this paper which consists of PV system, a dc/dc converter which is controlled by MPPT, three phase VSC to act as APF and Non-Linear Load. The main theme of this INC MPPT is to efficiency from the PV system. For reliable performance of active power filter and better harmonic compensation this paper propose a concept of instantaneous power theory. Also, a comparison analysis is performed for improving THD by PI/Fuzzy controllers. The proposed system is simulated and verified in MATLAB/SIMULINK software.

Keywords - Current, Total Harmonic Distortion, PV system, Power Quality

I. INTRODUCTION

In the present scenario, power quality and power supply are the main problems in power system. So that, the DG systems has got lot of importance because of the limitation of conventional power generation. The main advantage of DG system, it is more productive, high quality, and provide power to loads to maintain continuous administration. Therefore, the PV system is considered as an infinite, uncontaminated alternative resource. In PV systems, there is a possibility to convert direct sun energy to electrical energy without any interruptions. The efficiency of the solar system can be improved by using general MPPTs. The frequently used MPP techniques are given below:

1. P&O Technique.
2. INC Technique.
3. Fuzzy based MPPT Technique.

The maximum utilization of power electronic systems can produce nonlinearity in network, and its effects on overall system performance. To mitigate problems caused by harmonics, some filter components are used inside the system.

Generally, passive filters are a solution to reduce the harmonics. But these passive filters are responsible for resonance type problems occurred in grid. So that, active power filter is the better solution as compared to general filters for compensating harmonics.

In this paper, PV-Active Power Filter system is proposed which produces an UPF supply to utility and non-harmonic current to the loads.

II. STRUCTURE OF PV-APF SYSTEM

The effective utilization of generated power with more flexible can be achieved by the concept of Grid interconnected PV system. The utilization of PV system is rapidly increased in distribution network and also power quality problems have been detected that may affect the operation of the network. Generally, Harmonics are main responsible for creating distortions in the power system network, due to this the quality of power delivered to the customers reduces. In, order to overcome these type of power quality problems the basic compensation technique is filters. The combination of PV-APF has been implemented for several years. This PV-APF system has capable to compensate power factor, unbalances in current, current harmonics, and also to inject power developed by solar system with low THD.

III. PHOTOVOLTAIC ARRAY MODELING

In the PV network of electrical phenomenon, cell is the necessary part. For the raise in appropriate current, high power and potential difference, the sunlight dependent cells and their region unit joined in non-current or parallel fashion called as PV exhibit are used. In practical applications, each and every cell is similar to diode with the intersection designed by the semiconductor material. When the light weight is absorbed by the electrical marvel sway at the point of intersection, it gives the streams at once. The (current-voltage) and (Power-Voltage) attributes at absolutely unpredictable star intensities of the PV exhibit are represented in figure 3, whereas the often seen existence of most electrical outlet on each yield is shown in power diagram 2.

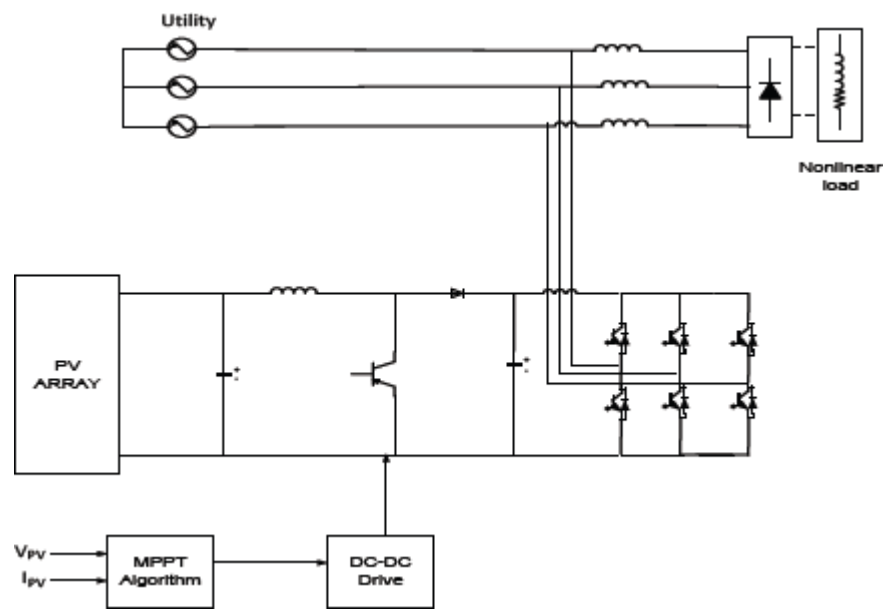


Fig 1. PV-active power filter system configuration

$$I = I_{ph} - I_D - I_{sh} \quad (1)$$

$$I = I_{ph} - I_o [\exp (q V_D / nKT)] - (v_D / R_s) \quad (2)$$

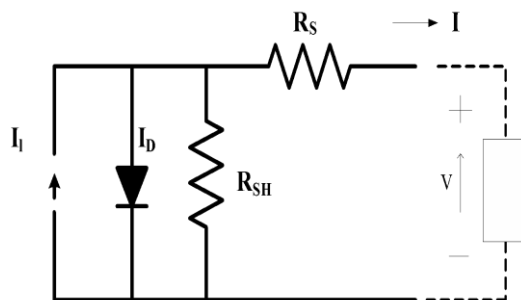


Fig 2: Solar cell output power is given as the product of V and I

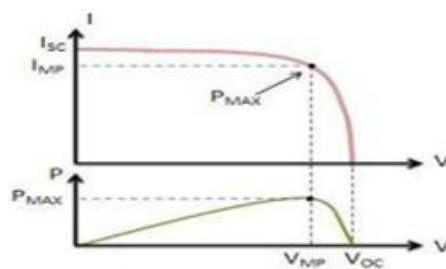


Fig 3: Response of output characteristics of PV Array

IV. INC MPPT TECHNIQUE

In this technique the change of PV voltage can be obtained with respect to MPP voltage peak power. Figure 4 shows the PV power curve for incremental conductance method.

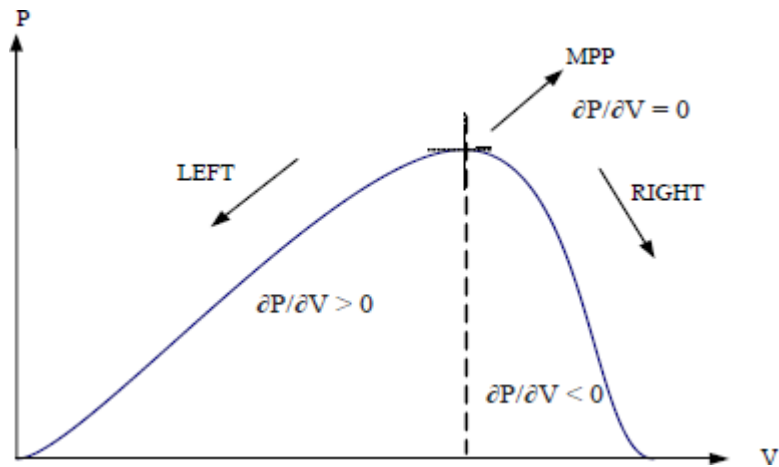


Fig 4. Characteristics of PV Power Vs Voltage under INC method

The relation for conductance in incremental and instantaneous can be expressed in three cases:

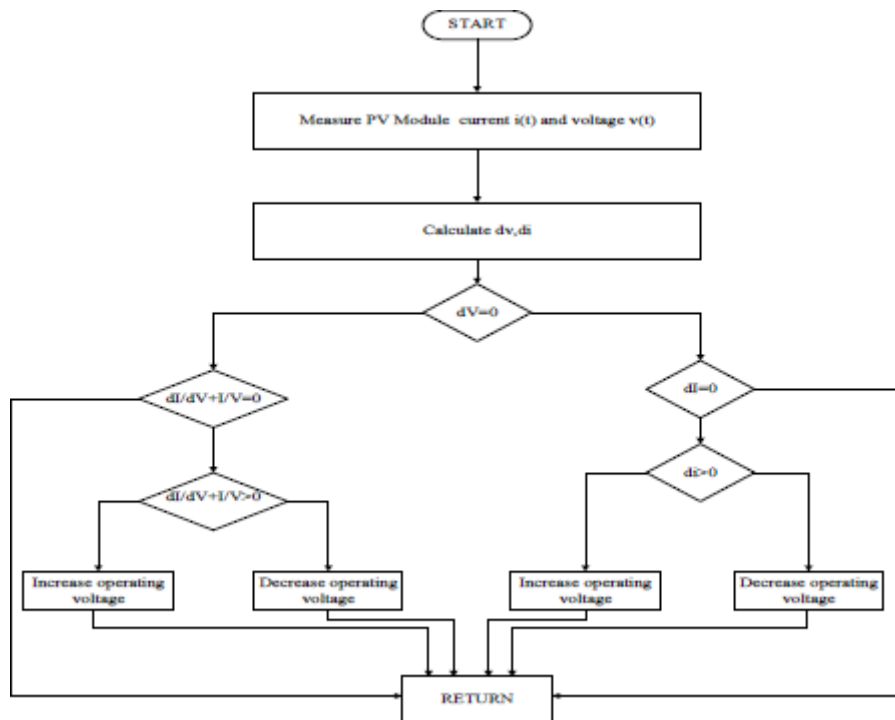


Fig 5: INC MPPT flow chart

The power expression,

$$P = V * I$$

Differentiate the above express w.r.t to PV terminal voltage,

$$\frac{\partial p}{\partial v} = \frac{\partial(VI)}{\partial v}$$

At MPP,

$$\frac{\partial p}{\partial v} = 0$$

The above equation can be written as:

$$\frac{\partial I}{\partial V} = -\frac{I}{V}$$

This MPPT technique controls PWM signal for boost converter until $(dI/dV) + (I/V) = 0$ is obtained. Figure 5 shows the INC MPPT flow chart.

V. P-Q THEORY FOR REFERENCE CURRENT GENERATION

The VSC integrated by APF should give better solution for harmonic elimination along with reactive power compensation and simultaneously inject the maximum power generated by the solar system. In order to control this system an instantaneous power theory is proposed in this paper. The reference signals for this controller is generated by using grid voltages, non-linear load currents, output currents of VSC, injected currents by APF and dc-link voltages. Since the target is laid on the load system, its consuming power is continuously measured and analyzed. The instantaneous active and reactive powers of load current and voltages can be obtained by using clarks transformation technique.

$$\begin{bmatrix} v_{\hat{a}} \\ v_{\hat{b}} \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & -1/2 & -1/2 \\ 0 & \sqrt{3}/2 & -\sqrt{3}/2 \end{bmatrix} \begin{bmatrix} v_a \\ v_b \\ v_c \end{bmatrix}$$

$$\begin{bmatrix} i_{\hat{a}} \\ i_{\hat{b}} \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & -1/2 & -1/2 \\ 0 & \sqrt{3}/2 & -\sqrt{3}/2 \end{bmatrix} \begin{bmatrix} i_a \\ i_b \\ i_c \end{bmatrix}$$

$$\begin{bmatrix} i_a^* \\ i_b^* \\ i_c^* \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & 0 \\ -\frac{1}{2} & \frac{\sqrt{3}}{2} \\ \frac{1}{2} & -\frac{\sqrt{3}}{2} \end{bmatrix} \begin{bmatrix} i_{\hat{a}} \\ i_{\hat{b}} \end{bmatrix}$$

VI. FUZZY LOGIC CONTROLLER

In the previous section, control strategy based on PI controller is discussed. But in case of PI controller, it has high settling time and has large steady state error. In order to rectify this problem, this paper proposes the application of a fuzzy controller shown in Figure 6. Generally, the FLC is one of the most important software based technique in adaptive methods.

As compared with previous controllers, the FLC has low settling time, low steady state errors. The operation of fuzzy controller can be explained in four steps.

1. Fuzzification
2. Membership function
3. Rule-base formation
4. Defuzzification.

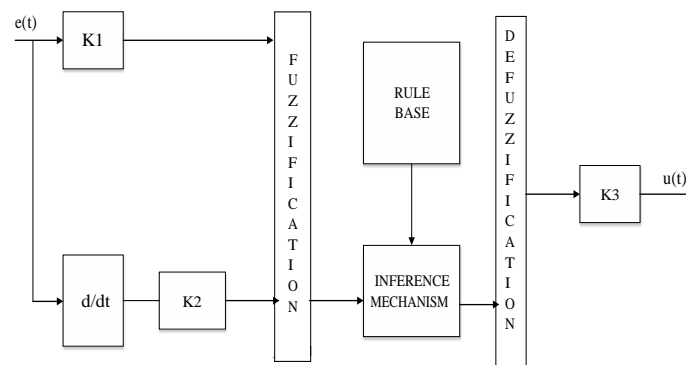


Figure 6: basic structure of fuzzy logic controller

In this paper, the membership function is considered as a type in triangular membership function and method for defuzzification is considered as centroid. The error which is obtained from the comparison of reference and actual values is given to fuzzy inference engine. The input variables such as error and error rate are expressed in terms of fuzzy set with the linguistic terms VN, N, Z, P, and Pin this type of mamdani fuzzy inference system the linguistic terms are expressed using triangular membership functions. In this paper, single input and single output fuzzy inference system is considered. The number of linguistic variables for input and output is assumed as 3. The numbers of rules are formed as 9. The input for the fuzzy system is represented as error of PI controller. The fuzzy rules are obtained with if-then statements. The given fuzzy inference system is a combination of single input and single output. This input is related with the logical operator AND/OR operators. AND logic gives the output as minimum value of the input and OR logic produces the output as maximum value of input.

VII. SIMULATION DIAGRAM AND RESULTS

The proposed hybrid system shown in figure 1 can be verified using Matlab/Simulink. The complete system can be simulated for the period of 0.75 sec and this can be divided into following sections. i.e, the period 0.05 to 0.35sec relates to VSC converter under dq-current controller without MPPT, between the periods 0.35 to 0.5sec relates to VSC dq-current controller with MPPT, between the periods 0.5 to 0.6sec corresponds to PV-APF mode and 0.6 to 0.7sec is APF mode.

Case 1: With PI Controller.

In this case the proposed system can be simulated using PI controller for compensating the current harmonics. The performance results for this proposed system and its total harmonic distortions are shown below.

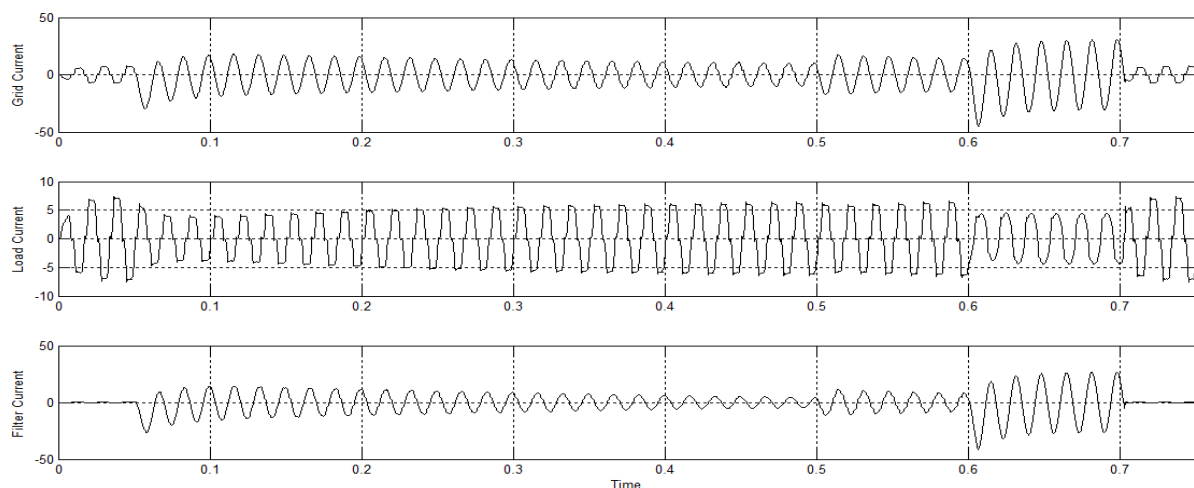


Fig 7. Waveforms for (a) Grid current. (b) Load current. (c) Filter current with PI controller

Case 2: With Fuzzy Controller

In this case the proposed system can be simulated using Fuzzy controller instead of conventional PI controller for compensating the current harmonics. The performance results for this proposed system and its total harmonic distortions are shown below.

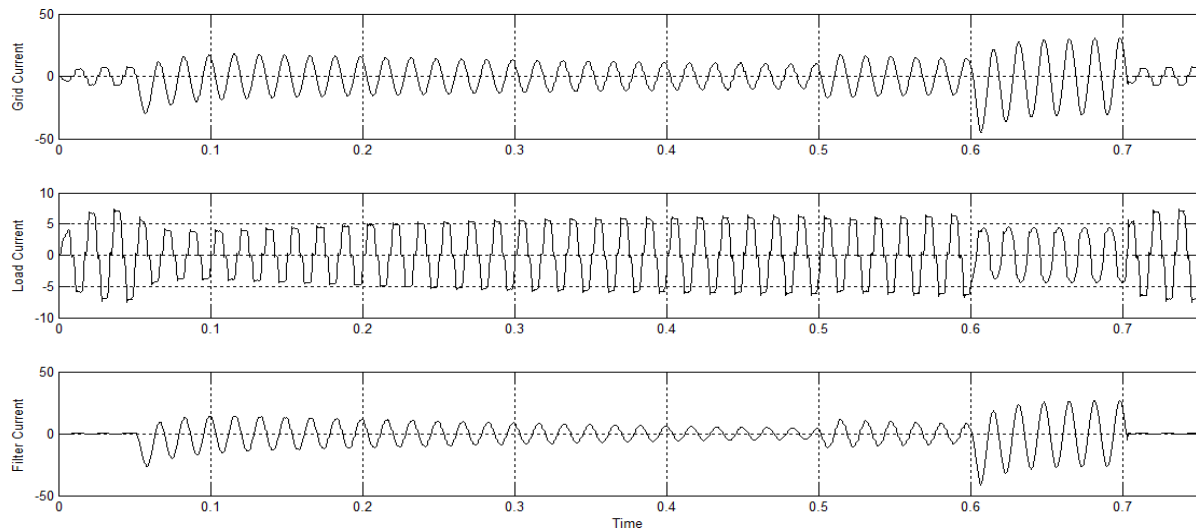


Fig 8 :Waveforms for (a) Grid current. (b) Load current. (c) Filter current with fuzzy controller

Table: %THDs Evaluation

Modes→ Type↓	d-q Current (0.07S)	PV-APF (0.5S)	APF (0.68S)	Utility (0.72S)
PI Controller	3.73	8.4	2.40	15.6
Fuzzy Controller	2.28	4.8	0.18	7.8

VIII. CONCLUSION

This paper proposed concept of PV based active power filter for power quality improvement using instantaneous power theory controller. This controller can be implemented for two purposes i.e, one for to supply power from PV system and other one is for filtering the harmonics caused by non-linear load. In this paper PI, Fuzzy Controllers are developed for controlling Dc link voltage. The performance of this system can be tested and verified in Matlab/Simulink. From the results we conclude that, FLC shows better performance over conventional PI controller.

REFERENCES

[1] Tuyen, Nguyen Duc, and Goro Fujita. "PV Active Power Filter Combination Supplies Power to Nonlinear Load and Compensates Utility Current", IEEE Power and Energy Technology Systems Journal, 2015.

[2] Villalva MG, Gazoli JR, Filho ER. Comprehensive approach to modeling and simulation of photovoltaic arrays. IEEE Trans Power Electron. 2009; 24(5):1198–208.

[3] Kuo YC, Liang TJ, Chen JF. Novel maximum-power-point tracking controller for photovoltaic energy conversion system. IEEE Trans Ind Electron. 2001; 48(3):594–601.

[4] Houssamo I, Locment F, Sechilariu M. Experimental analysis of impact of MPPT methods on energy efficiency for photovoltaic power systems. Int J Elect Power Energy Syst. 2013; 46:98–107.

- [5] Tuyen ND, Fujita G. PV-active power filter combination supplies power to nonlinear load and compensates utility current. *IEEE Power and Energy Technology Systems Journal*. 2015; 2(1):32–42.
- [6] Rezvani F, Mozafari B, Faghihi F. Power quality analysis for photovoltaic system considering unbalanced voltage. *Indian Journal of Science and Technology*. 2015 Jul; 8(14):1–7.
- [7] Kanth KM, Kishore RD. Implementation of MPPT techniques for a high step-up converter with voltage multiplier module based photovoltaic system. *Indian Journal of Science and Technology*. 2015 Sep; 8(23):1–6
- [8] Das JC. Passive filters-potentialities and limitations. *IEEE Trans Ind Appl*. 2004; 40(1):232–41.
- [9] Akagi H. Active harmonic filters. *Proc IEEE*. 2005; 93(12):2128–41.
- [10] Akagi H, Kanagawa Y, Nabae A. Generalized theory of the instantaneous reactive power in three-phase circuits. *Proc Int Conf Power Electron*; Tokyo, Japan. 1983. p. 1375–86.
- [11] Afonso J, Martins CJ. Active filters with control based on the p-q Theory. *IEEE Industrial Electronics Society Newsletter*; 2000 Sep. p. 5–10.